

AC WITH EXIT SIGN MOUNTING METHOD



WARNINGS


- 1 This appliance must only be installed by a competent person in accordance with the requirements of the Codes of Practice or the rules in force.
- 2 All external wiring **MUST** comply with the current IEE wiring regulations.
- 3 Warning this appliance must be earthed.

This addendum to the current AC O & M manual (document reference **GB/AIR/047/0312**) describes the mounting method to be used only with the exit sign versions of Airbloc AC air curtains.

The differences to the mounting method are:

- ◆ The use of 10mm threaded drop rods instead of 12mm.
- ◆ The holes in the bracket to be used for the drop rods.

The drop rods should be fed through the top and bottom mounting bracket holes as shown below. Locking nuts must be used to prevent drop rods from becoming loose (refer to main O & M manual for full installation instructions).

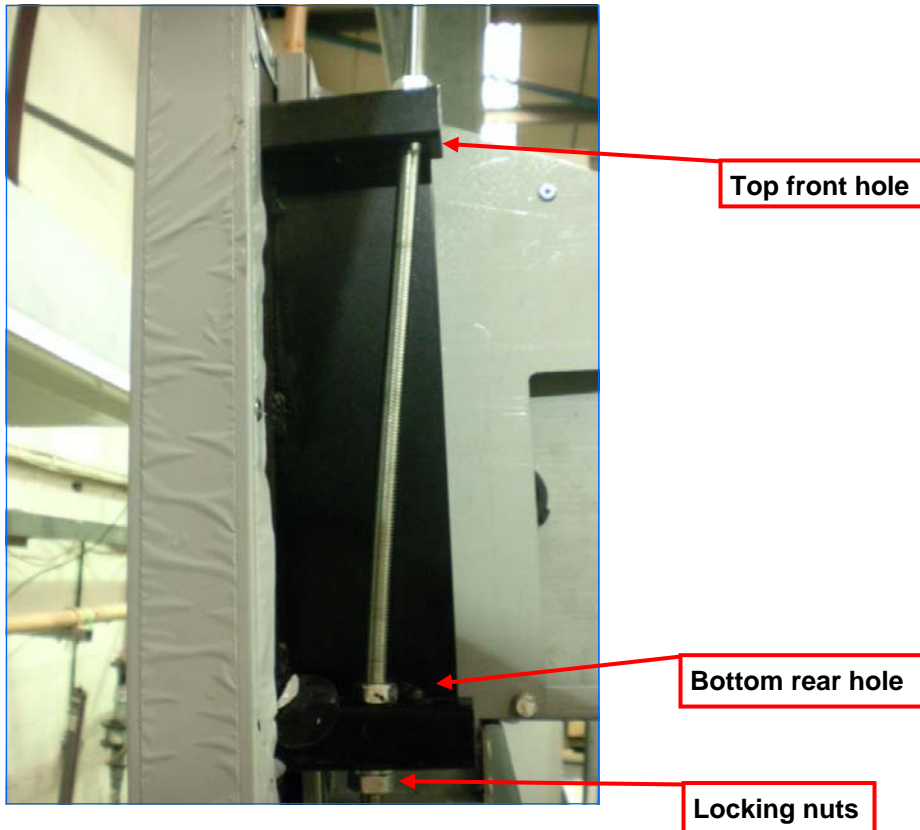

AmbiRad Limited Fens Pool Avenue
Brierley Hill West Midlands DY5 1QA
United Kingdom.

Telephone 01384 489700
Facsimile 01384 489707
Email marketing@airbloc.co.uk
Website www.airbloc.co.uk
Technical Support www.s-i-d.co.uk

An AmbiRad Group brand

AIRBLOC
ENERGY SAVING AIR CURTAINS

Airbloc is a registered trademark of AmbiRad Limited. Because of continuous product innovation, AmbiRad reserve the right to change product specification without due notice.