


## HONEYWELL VK GAS VALVE

FOR VISION® RADIANT TUBE HEATERS

### NOTIFICATION BULLETIN

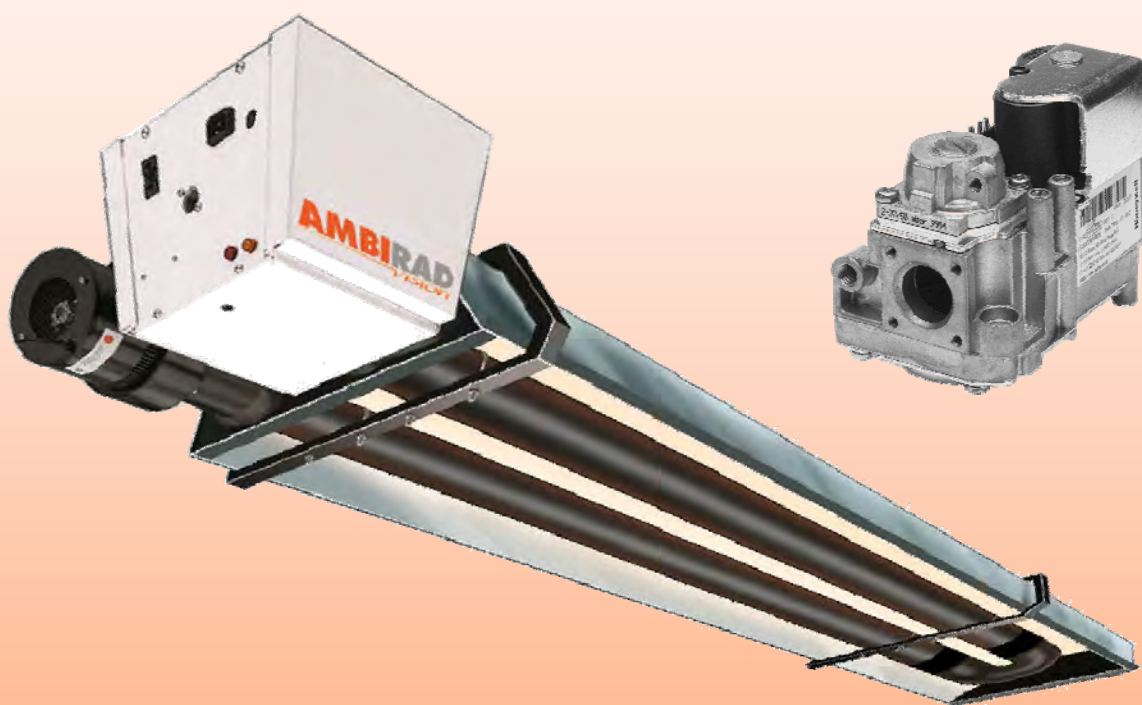

#### INDEX

#### Section

General Information -----	1
Adjustment -----	2

#### WARNINGS

Nortek Global HVAC (UK) Ltd equipment must be installed and maintained in accordance with the relevant provisions of the Gas Safety (Installations and Use) Regulations 1998 for gas fired products. Due account should also be taken of any obligations arising from the Health and Safety at Works Act 1974 or relevant codes of practice. In addition the installation must be carried out in accordance with the current IEE wiring regulations (BS 7671), BS 6896 (Industrial & Commercial) and any other relevant British Standards and Codes of Practice by a qualified installer. All external wiring MUST comply with the current IEE wiring regulations.

Part No. 700093



# 1. General Information.

Due to on-going improvements, the gas valves fitted to the Vision range of radiant heaters are being changed from the current SIT valve (Fig.1) and White Rodgers (Fig.2), to the new Honeywell valve (Fig.3). The new valves are suitable for Natural gas part no. 202658 and Propane part no. 202657.



**Fig.1**  
SIT 840 Sigma  
AmbiRad no. 201857 (201914)

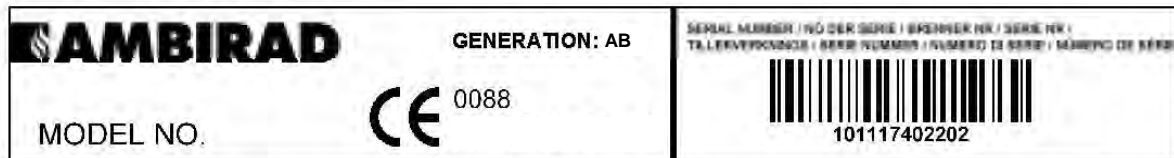


**Fig.2**  
White Rodgers 36J  
AmbiRad no. 202404 (202528)



**Fig.3**  
Honeywell VK4105C(A)  
AmbiRad no. 202658 (202657)

Burners fitted with the new Honeywell valve will be labelled with generation code: AB so that the valve can be identified for spares purposes. Example burner label shown below:




**For spares purposes:** Only Vision burners currently fitted with White Rogers gas valves part Nos. 202404 and 202528 with generation code 'AA' can be replaced with the new Honeywell gas valves.

A kit of parts has been created for replacement spares. This kit will take form of the valve, mini valve harness, rubber spacer and two off M4 x 10 Screws. Part number for Natural Gas valve kit replacement is **202748** and part number for Propane Gas valve Kit replacement is **202749**.

Note: Vision burners currently fitted with SIT 840 Sigma Gas Valves part no's. 201857 and 201914 can **NOT** be replaced with the new Honeywell gas valve. SIT valves will be made available as spares.

# 2. Honeywell Gas Valve Adjustment

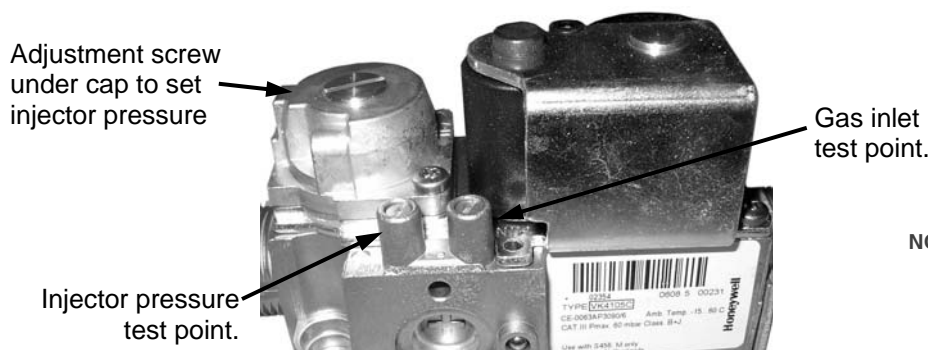

NORTEK GLOBAL HVAC (UK) LTD  
Fens Pool Avenue  
Brierley Hill  
West Midlands DY5 1QA  
United Kingdom

Tel: 01384 489 250  
Fax: 01384 489 707

ambiradsales@nortek.com  
www.ambirad.co.uk



Document reference number TB/093/0914  
Replaces TB/093/0813